

# Modeling of Zeta converter based DVR system for power quality improvement

P.Velmurugan<sup>#1</sup>, B.Baskaran<sup>\*2</sup> and G.Irusapparajan<sup>#3</sup>

<sup>#</sup> Research Scholar, Department of Electrical Engineering, Annamalai University,  
Annamalai nagar - 608002, India.

<sup>1</sup> velupriya10@gmail.com

<sup>\*</sup> Professor, Department of Electrical Engineering, Annamalai University,  
Annamalai nagar - 608002, India.

<sup>2</sup> baskarancdm@gmail.com

<sup>#</sup> Professor, Department of Electrical and Electronics Engineering, Mailam Engineering College,  
Mailam, Villupuram – 604 704, India.

<sup>3</sup> irusgkm@gmail.com

**Abstract— A new development of voltage control scheme for power quality improvement such as voltage sag, swell, harmonics, and transient conditions in three-phase power systems has been proposed. Faults occurring in power distribution systems or amenities can inject the voltage sag or swell. This fault can damage or affect the power transmission and distribution. For sensitive loads, the short duration of voltage sags also cause huge problems in the entire power system. In order to reduce power interruptions, this work proposes a novel Zeta converter based DVR system. This proposed scheme can quickly access the voltage sag and swell under transient condition.**

Dynamic Voltage Restorer, Power Quality, Series Compensation, Voltage Sag/Swell, Zeta Converter

## I. INTRODUCTION

Power quality is “the provision of voltages and system design in such a way that the electric energy is utilized from the distribution side successfully without interference or interruption.” Power quality is the most important concerned area of electric power system. The insufficient quality of power output sometimes leads to complete shutdown of the industries which provides a major economic loss to the industries and consumers [4,5,6]. The industries always demand the supplier or utility for high quality power. But the blame due to degraded quality depends not only upon the utility but also depends on the conditions that can disrupt process that are generated within the industry itself. Most of the industries use non-linear loads which cause transients and it can affect the quality of the power supply [8,9]. Some abnormal electrical conditions such as Voltage sags, swell, Phase outages, Voltage interruptions and Harmonics are generated both at utility and consumer end due to the presence of nonlinear loads [3,7,10].

FACTS (Flexible AC Transmission Systems) and Custom power devices are the best examples for the utility and consumer end power quality solutions. Uninterruptible Power Supplies (UPS), Dynamic Voltage Restorers (DVR) and Active Power Filters (APF) are examples for commonly used custom power devices.

Among these three custom power devices, DVR is the most efficient and effective custom power device that is used to compensate voltage sag and swell conditions [1,5,11,12]. DVR appeals reasonable cost, portable size and fast dynamic response to the disturbance. The basic operation of DVR is to inject a voltage of the required magnitude, phase angle and frequency in series with distribution feeder to maintain the desired amplitude and waveform for load voltage even when the source voltage is unbalanced or distorted [13–16].

There are a number of voltage sag/swell mitigating methods available, but the use of tradition power service is considered to be the most efficient method. This paper introduce a new concept of Zeta converter based DVR (Dynamic Voltage Restorer). The performance of DVR depends on the efficiency of control technique of switching zeta converter. In this paper PI controller based control method is used to compensate voltage sag/swell. The proposed control technique is modelled based on MATLAB/ Simulink.

## II. DYNAMIC VOLTAGE RESTORER

DVR is a custom power device which acts as a harmonic isolator and prevents the harmonics in the source side. In addition it balances the voltages and provides voltage regulation. In order to regulate the load side voltage, DVR is a recently proposed scheme which is a series connected solid state device that injects voltage into the system.

The main function of DVR is to boost up the load side voltage in the place of disturbance in order to avoid any power disruption to the load. There are many control technique available to implement the DVR. The primary function of DVR is to compensate voltage sags and swells apart performing the tasks such as: harmonic compensation, reduction of transient in voltage and fault current limitation [17,18]. The proposed DVR system

consists of an injection transformer, zeta converter, filter, voltage source converter and control & protection system. Fig.1 shows the schematic representation of proposed zeta converter based DVR control system.

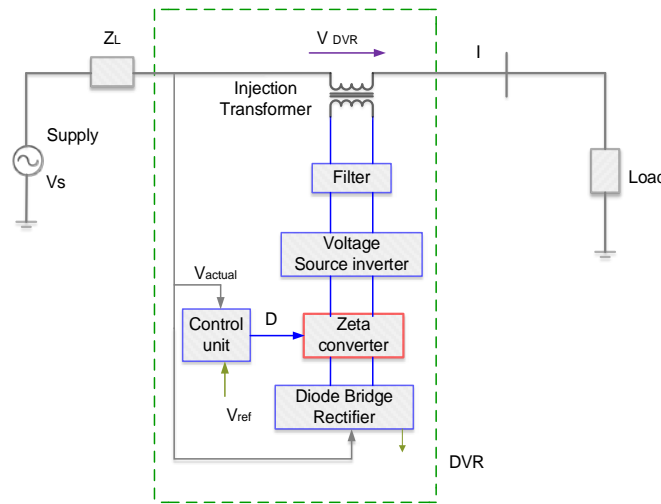


Fig.1 Schematic representation of zeta converter based DVR control system

**A. Zeta Converter**

Different types of AC-DC converters have been introduced to fulfil the demanded power conversion such as sepic, cuk converters etc. From the available converters the zeta converters (Buck-Boost type) is incorporated in the proposed work. The zeta converter has advantages such as, safety, flexibility, isolation and output adjustment. Zeta converters usually have high transfer voltage gain and also produce high insulation on both sides. The gain of the Zeta converters always depends on the transformer’s turn ratio N, which can be thousand times. The zeta converter is a transformer based converter with a low-pass filter. Its output voltage ripple value is small [19,20]. The circuit diagram of zeta converter is shown in Fig.2.

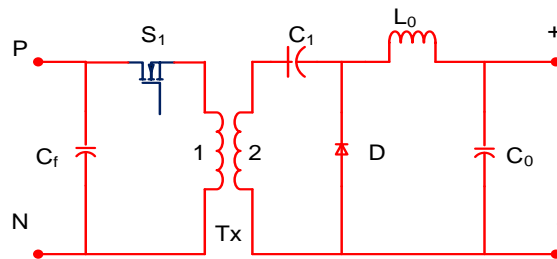


Fig.2. Circuit diagram of zeta converter

The output voltage is given by,

$$V_o = \frac{k}{1-k} NV_{in}$$

Where N is the turn ratio of transformer, and k is the conduction duty cycle  $k= t_{on}/T$ .

**B. Voltage Source Inverter**

The function of the VSI is to convert the DC voltage into an AC voltage which is supplied by zeta converter. Step up voltage injection transformer is used in DVR power circuit, which enables VSI of low voltage rating to cope up the requirements [21].

**C. Injection Transformer**

In distribution line secondary side of the injection transformer is connected in series, while the primary side is connected to zeta converter based DVR. The function of the injection transformer is to inject the voltage supplied by the filtered zeta converter based VSI [21]. The injection transformer winding ratio will increase the primary side current, depending upon the performance of the zeta converter based VSI.

**D. Harmonic Filter**

The role of harmonic filter is to filter out the self-generated harmonics generated by DVR which is composed of power electronic devices. The main function of harmonic filter is to keep the harmonic voltage content to acceptable level which is generated by the zeta converter fed VSC.

E. Control and Protection circuit

A controller is also used for the proper function of the DVR system. Load voltage from the DVR is sensed and passed through a sequence analyzer. The load voltage magnitude is compared with reference voltage. Duty cycle control technique is applied for zeta converter switching to generate a DC voltage equivalent to three phase quantity which is to be fed through voltage source inverter at the load terminals.

The input voltage of zeta converter is extracted from transmission line and fed through diode bridge rectifier. PI controller is used with zeta converter to maintain the voltage at the load terminals. The controller input is used as an actuating signal which is a measure of the difference between the  $V_{ref}$  (reference voltage) and  $V_{in}$  (actual voltage). An advantage of this proportional plus integral controller is to produce integral term which results in the steady-state error to become zero for a step input [22,23].

III.COMPENSATION OF ZETA CONVERTER BASED DVR

Fig.3 shows the operation of the DVR that injects a controlled voltage generated by the zeta converter fed voltage source inverter in series to the system voltage by means of an injecting transformer. The zeta converter regulates the voltage by varying duty ratio control using PI controller. During normal operating condition the DVR injects very low voltage to compensate the voltage drop in the injection transformer and device losses and drop. When sag/swell occurs in the distribution system [24], the zeta converter based DVR system either injects/absorbs required control voltage to preserve output voltage to the load side. Switching pattern of the VSI can be inversed during sag/swell conditions. The DVR system is capable of generating or absorbing reactive power. In the proposed system the active power injection of the DVR must be provided by zeta converter which is connected to the same system. The response time of DVR is very small, and it is limited by the power electronics devices apart from the voltage sag/swell detection time.

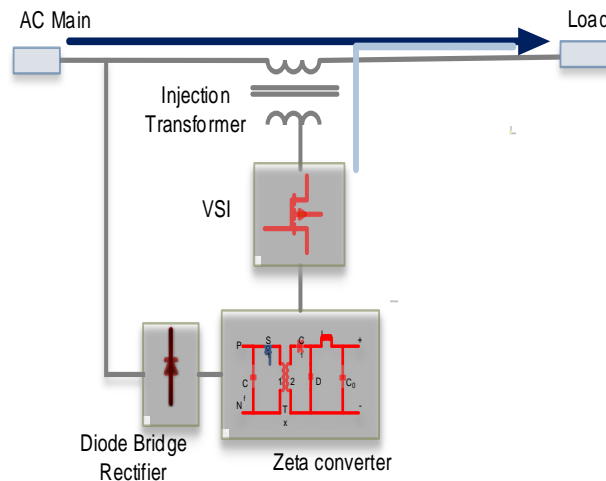


Fig.3. Compensation principle of zeta converter based DVR system

The injected voltage by DVR is mathematically expressed by the following equation

$$V_{inj(DVR)} = V_S + Z_L I_L - V_L$$

Where,  $V_L$  is the load voltage,  $V_S$  is supply voltage during sag and  $V_{inj(DVR)}$  is the voltage injected by DVR. Under normal voltage conditions, the load current can be written using the following equation

$$I_L = \frac{S_L}{V_L} = \frac{(P_L - jQ_L)}{V_L}$$

Where,  $I_L$  is the load current,  $P_L$  and  $Q_L$  are the active and reactive power taken by the load respectively during a sag/swell. When DVR inject voltage, the complex power is given by the following expression

$$S_L = (S_s + S_{inj})$$

And the load current can be expressed by the following equation

$$I_L = [(P_s - jQ_s) + (P_{inj} - jQ_{inj})] / V_L$$

#### IV. SIMULATION RESULTS

A 440V, 50Hz, power distribution system configuration is simulated using Math works Matlab/Simulink to study the effectiveness and response of suggested DVR control strategy under supply disturbances (Line-ground fault). Zeta converter based DVR is connected in series with line for compensation. Zeta converter is controlled by the PI controller by varying the duty ratio. Here DVR system is connected in series to the distribution system by using an injection transformer. The DVR operation is based on three phase voltage source inverter with LC output filter to remove high frequency voltage components. An inductive nature  $R-L$  load ( $R=1K\Omega$ ,  $L=1\text{microh}$ ) is considered for evaluation of proposed system. Fig.4 and 5 shows the Simulink model of the proposed system and Zeta converter based DVR. The simulation results are presented to prove the possibility of the proposed system.

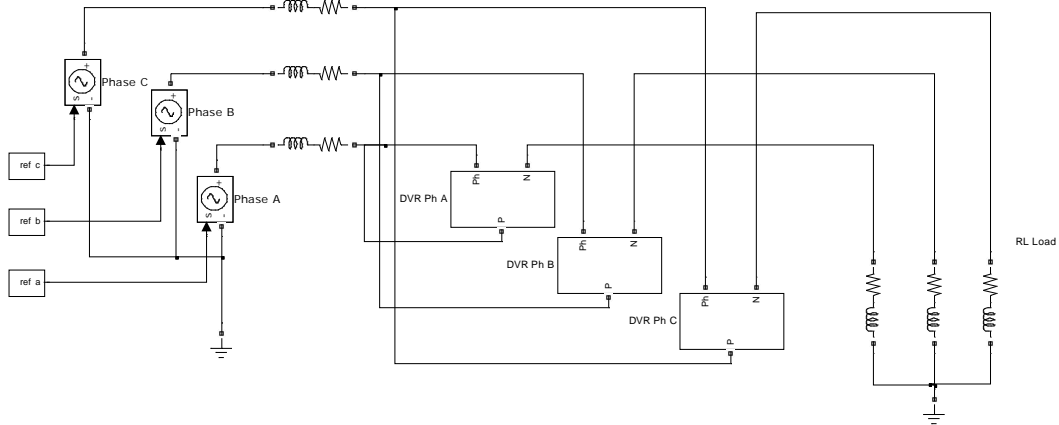


Fig.4. overall Simulink model of Zeta converter based DVR control system for power quality improvement

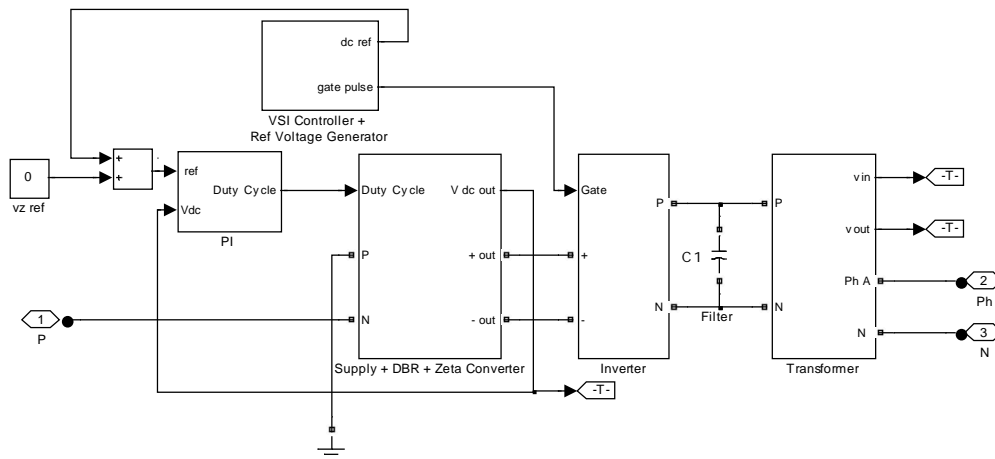


Fig.5. Simulink model of Zeta converter based DVR

##### A. Results of proposed system with voltage sag

In this proposed system voltage sag is introduced in both the feeders for the duration of 1.4s to 1.5s using phase to ground fault. The output and results for the above system are shown below. Figs.6- 9 shows the input and output responses during sag the occurrence of condition in the test system. Fig.6 shows the source voltage with sag, load voltage after compensated by DVR and DVR output voltage. Fig.7 shows the real power injected by DVR system, Fig.8 shows the reactive power compensated by DVR system and Fig.9 shows the DC injected voltage by DVR, Zeta converter output voltage and reference voltage for converter during sag condition.

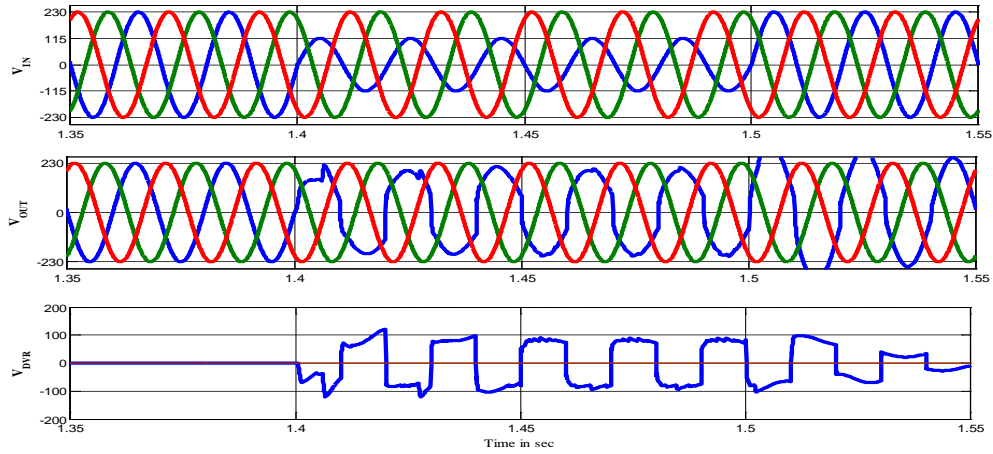


Fig.6. Simulated voltage response of proposed test system during sag condition Source voltage, Load voltage and Voltage injected by DVR

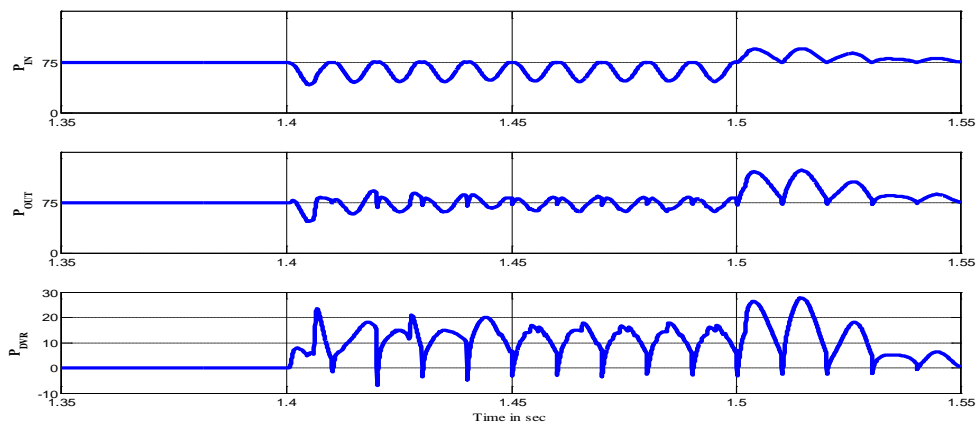


Fig.7. Simulated real power response of proposed test system (a) Power at source end (b) Power at load end (c) Power injected by DVR

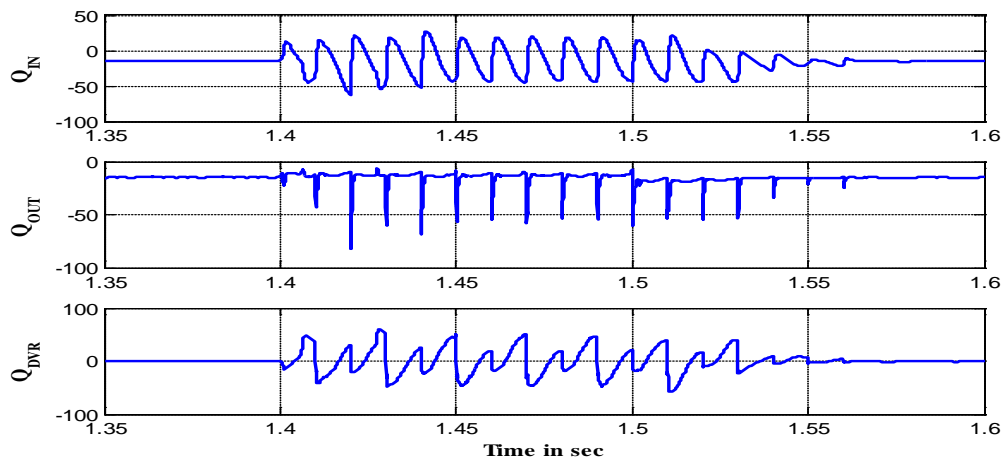


Fig.8. Reactive power compensated by DVR

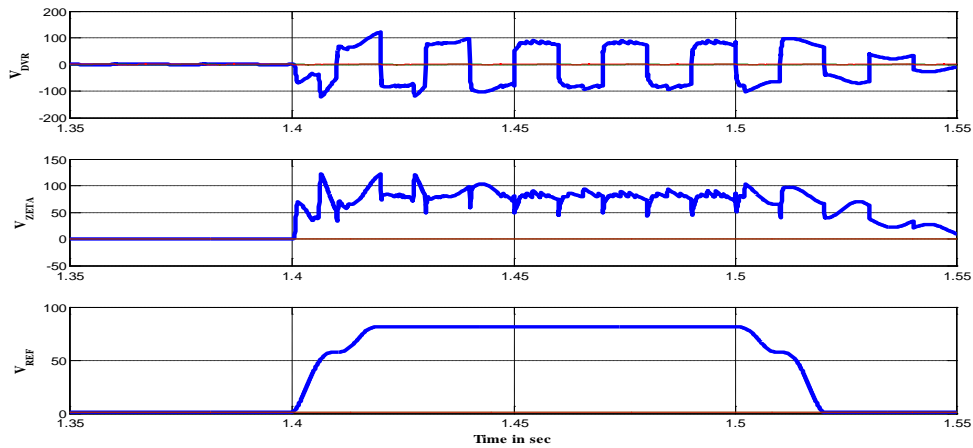


Fig.9. DC reference voltage and zeta converter voltage during sag condition

**B. Results of proposed system with voltage swell**

In this system voltage swell is introduced in both the feeders for the duration of 1.0s to 1.1s using phase to ground fault. The output results for the above system are shown below. Figs.10-13 shows the input and output responses during the occurrence of swell condition in the test system. Fig.9 shows the source voltage with swell, load voltage after compensated by DVR and DVR output voltage. Fig.10 shows the real power injected by DVR system, Fig.11 shows the reactive power compensated by DVR system and Fig.12 shows the DC reference voltage and zeta converter voltage during swell condition.

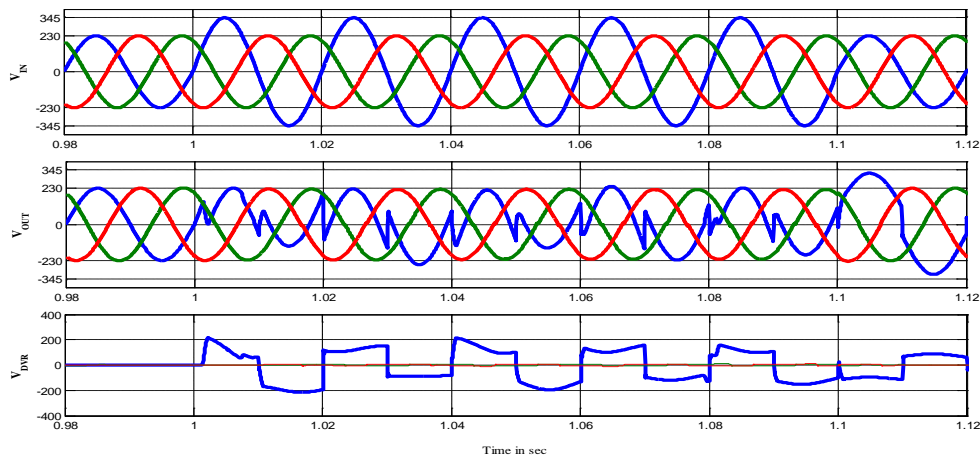


Fig.10. Simulated voltage response of proposed test system during swell condition Source voltage, Load voltage and Voltage injected by DVR

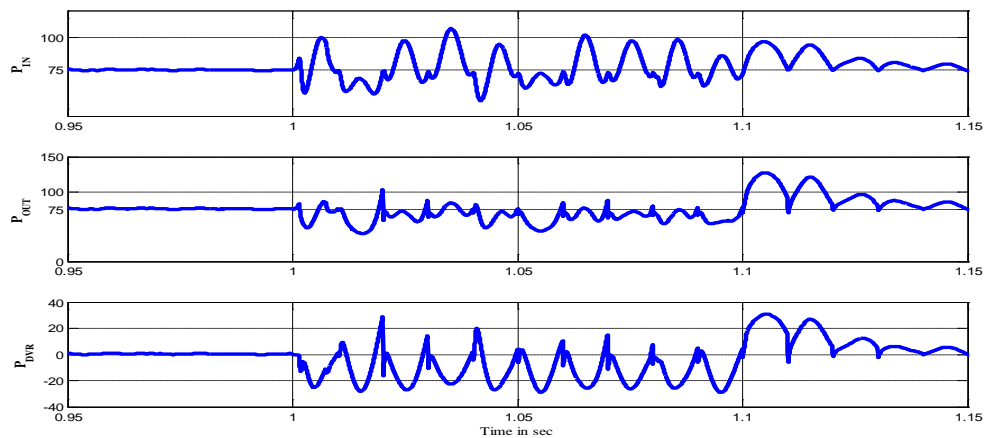


Fig.11. Simulated real power response of proposed test system Power at source end, Power at load end and Power injected by DVR

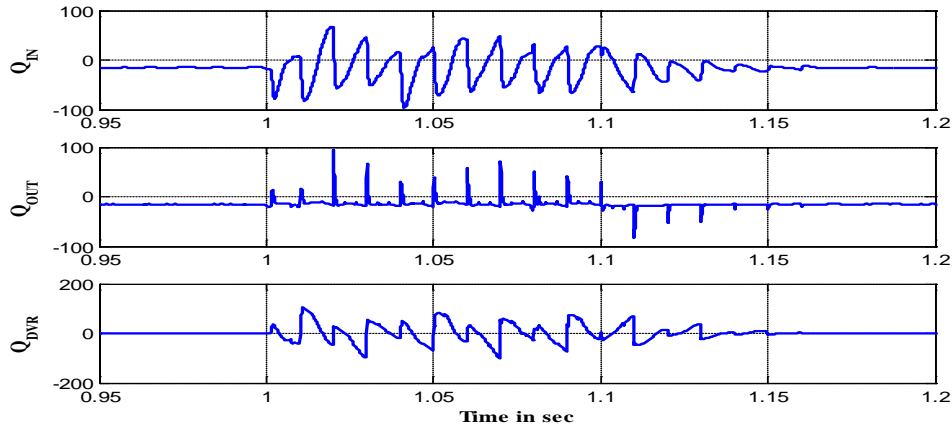


Fig.12. Reactive power compensated by DVR

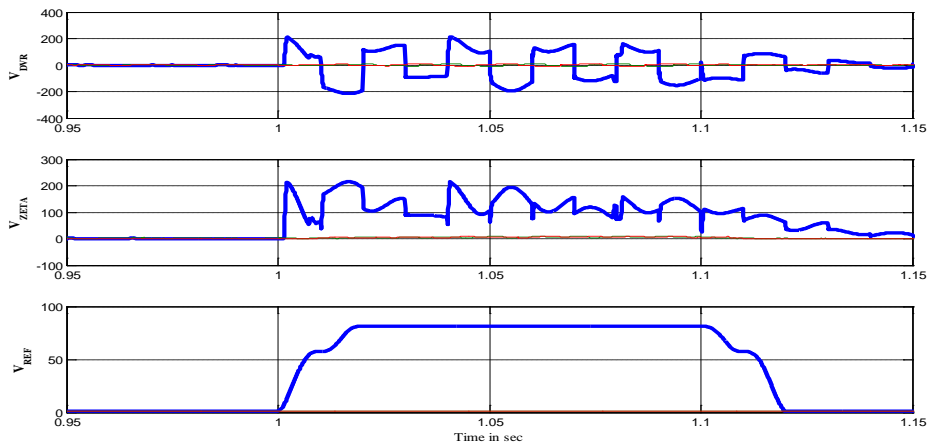


Fig.13. DC reference voltage and zeta converter voltage during swell condition

### V. CONCLUSION

In this work, a fast response and cost effective based Dynamic Voltage Restorer (DVR) is proposed for compensating the problems of voltage sag and swell condition in distribution systems, the effectiveness of DVR using PI controller is established for nonlinear load. Other kinds of controllers like fuzzy controller and adaptive PI fuzzy controller may be employed in the DVR compensation scheme in future.

### APPENDIX

- System: 440V, 50 Hz
- Zeta converter:  $L_o = 500\mu\text{H}$ ,  $C_1, C_d = 400\mu\text{F}$ ,
- PI controller:  $K_p = 54.6363$ ,  $K_i = 139.729$
- Filter:  $C_f = 400\mu\text{F}$ ,  $L = 100\mu\text{H}$
- Voltage sag at 1.4 sec to 1.5 sec
- Voltage swell at 1 sec to 1.1 sec
- Load:  $R=1\text{K}\Omega$ ,  $L=1\text{mH}$

### REFERENCES

- [1] I.Y. Chung, D.J. Won, S.Y. Park, S-I. Moon, J.K. Park, "The DC link energy control method in dynamic voltage restorer system", ELSEVIER Electrical Power and Energy Systems, Vol.25, pp.525-531, 2003.
- [2] D.M. Lee, T.G. Habetler, R.G. Harley, J.Rostron, T.Keister, "A voltage sag supporter utilizing a PWM switched autotransformer", IEEE Power Electronics Specialists Conference, Aachen, Germany, pp.4244 – 4250, 2004.
- [3] K.R. Agileswari K. R, Rengan K.I, Dr. R.N. Mukerjee, Dr. Vigna K.R, "Dynamic Voltage Restorer for voltage sag compensation", IEEE PEDS, pp.1289-1293, 2005.
- [4] C. Fitzer, M. Barnes, Peter Green, "Voltage sag detection technique for a dynamic voltage restorer", IEEE transactions on Industry applications, Vol.40, No.1, pp.203- 212 Jan/Feb. 2004.
- [5] A. Domijan, A. Montenegro, A.J. F. Keri, Kenneth E. "Custom Power Devices: An Interaction Study", IEEE transactions on Power Systems, Vol.20, No.2, pp.1111-1118, May 2005.
- [6] P. Daehler, R. Affolter, "Requirements and solutions for Dynamic Voltage Restorer, a case study" (the summary of the presentation for the panel session "Method for voltage sag mitigation") Power Winter Meeting, Singapore, January 23-27, 2000.
- [7] N.G. Hingorani, "Introducing custom power" IEEE spectrum, pp. 41-48, June 1995.

- [8] N.H. Woodley, "Field Experience with Dynamic Voltage Restorer Systems", (the summary of the presentation for the panel session "Method for voltage sag mitigation") Power Winter Meeting, Singapore, January 23-27, 2000.
- [9] N.H. Woodley, A. Sundaram, T. Holden, T. Einarson, "Field Experience with New platform-mounted DVR", (Session on "Power quality improvement methods" POWERCON 2000 Conference, Western Australia.
- [10] A.E. Mofty, K. Youssef, "Industrial power quality problems" Alexandria Electricity Company, Alexandria, Egypt, pp.18-21, June 2007.
- [11] C. Fitzer, A. Arulampalam, M. Barnes, Z. Rainer, "Mitigation of saturation in dynamic voltage restorer connection transformers", IEEE Transactions on Power Electronics, Vol. 17, No.6, pp. 1058-1066, Nov. 2002.
- [12] P.T. Nguyen, T.K. Saha, "Dynamic voltage restorer against balanced and unbalanced voltage sags: Modelling and simulation", IEEE transactions on Power Delivery, pp.1-6, 2004.
- [13] A.K. Jindal, A. Ghosh, A. Joshi, "Critical load bus voltage control using DVR under system frequency variation", Elsevier J. Electric Power Syst. Res. vol.78, No.2, pp. 255-263, 2008.
- [14] Y.W. Li, D.M. Vilathgamuwa, F. Blaabjerg, P.C. Loh, "Investigation and improvement of transient response of DVR at medium voltage level", IEEE Trans. Ind. Appl. Vol.43, No.5, pp. 1309-1319, 2007.
- [15] C. Fitzer, M. Barnes, P. Green, "Voltage sag detection technique for a dynamic voltage restorer", IEEE Trans. Ind. Appl. Vol.40, No.1, pp. 203-212, 2004.
- [16] H.K. Al-Hadidi, A.M. Gole, D.A. Jacobson, "A novel configuration for a cascade inverter -based dynamic voltage restorer with reduced energy storage requirements", IEEE Trans. Power Del. Vol.23, No.2, pp.881-888, 2008.
- [17] O. Rosli and A.R. Nasrudin "Modeling and Simulation for Voltage Sags/Swells Mitigation Using Dynamic Voltage Restorer (DVR)", 2008 Australasian Universities Power Engineering Conference (AUPEC'08).
- [18] A.L. Fawzi "Modeling and Simulation of Dynamic Voltage Restorer (DVR) Based on Hysteresis Voltage Control", Proceedings of 33<sup>rd</sup> Annual Conference of the IEEE Industrial Electronics Society (IECON) Nov. 5-8, 2007, Taipei, Taiwan.
- [19] N. Mohan, T.M. Undeland, and W.P. Robbins, "Power Electronics: Converters, Applications and Design", 3<sup>rd</sup> edition, John Wiley & Sons, New York, 2003.
- [20] F.L. Luo and H. Ye "Advanced DC/DC Converters" CRC PRESS Boca Raton London New York Washington, D.C. 2004.
- [21] C. Zhan, V.K. Ramachandaramurthy, A.Arulampalam, C.Fitzer, S.Kromlidis, M.Barnes, N.Jenkins, "Dynamic voltage restorer based on Voltage space vector PWM control", IEEE transactions on Industry applications, Vol. 37, No.6, , pp. 1855-1863, Nov./Dec. 2001.
- [22] D.N.Katole Research scholar: Department of Electrical Engineering. G.H.Raisoni College of engineering Nagpur, Maharashtra, India. "Analysis and Mitigation of Balanced Voltage Sag with the Help of Energy Storage System" ICETET pp. 317-321, 2010.
- [23] H.P. Tiwari and Sunil Kumar Gupta "Dynamic Voltage Restorer against Voltage Sag" International Journal of Innovation, Management and Technology, vol. 1, No. 3, pp. 232- 237, 2010.
- [24] M A Hannan and A Mohamed, "Modeling and Analysis of a 24- Pulse Dynamic Voltage Restorer in a Distribution System", Student Conference on Research and Development proceedings, Shah Alam, Malaysia, pp. 192-195, 2002.

#### AUTHORS BIBLIOGRAPHY



P.Velmurugan was born in Virudhachalam, India in 1986. He has obtained Bachelor of Electrical and Electronics Engineering and Master of Engineering in Power Electronics and Drives from Anna University, Chennai in 2007 and 2009 respectively. Currently he is pursuing Ph.D in Annamalai University. He is doing his research work in the area of improved power quality converters and applications.



B.Baskaran was born in Nagapattinam, India in 1963. He has obtained Bachelor of Electrical and Electronics Engineering, Master of Engineering in Power systems and Ph.D from Annamalai University in 1985, 1991 and 2013 respectively. Currently he is a professor in the Department of Electrical Engineering, Annamalai University. Where he has put in a total service of 27 years since 1987. He has published many international and national journals. His area of interest include modelling, simulation and intelligent control for matrix converter.



G.Irusapparajan, received his B.E. Degree from Manonmaniam Sundaranar University in 2000, M.E degree from Annamalai University in 2005, M.H.R.M., from Annamalai University in 2008. He was received his Ph. D from Bharath University in 2011, in the area of Power System. He has more than 11 years of teaching experience. He has published 10 research papers in reputed international journals and conferences. His research areas are FACTS and Power Electronic Drives.